




OUTPUT POWER

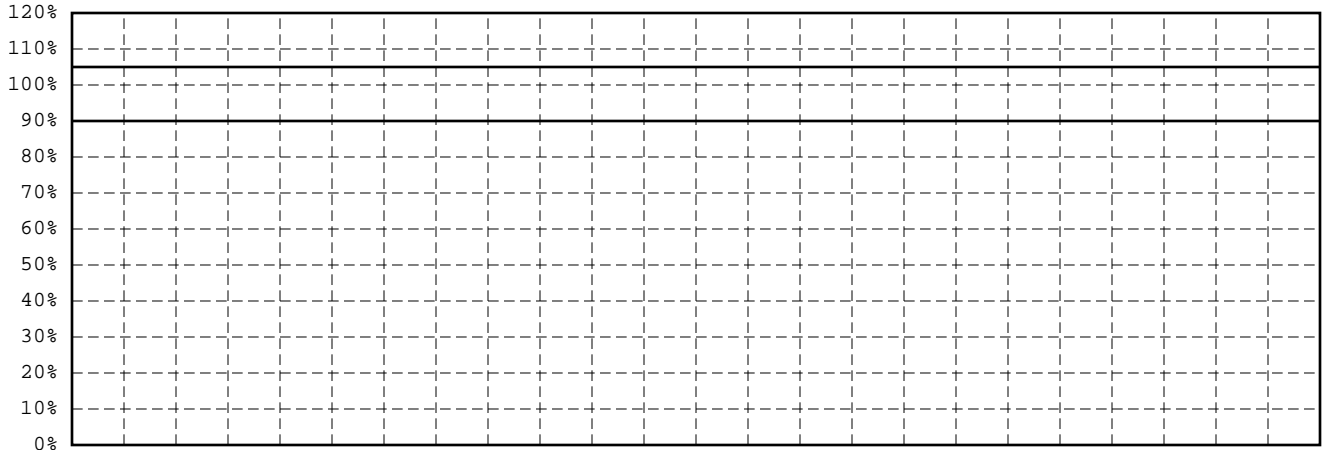


TEMPERATURES

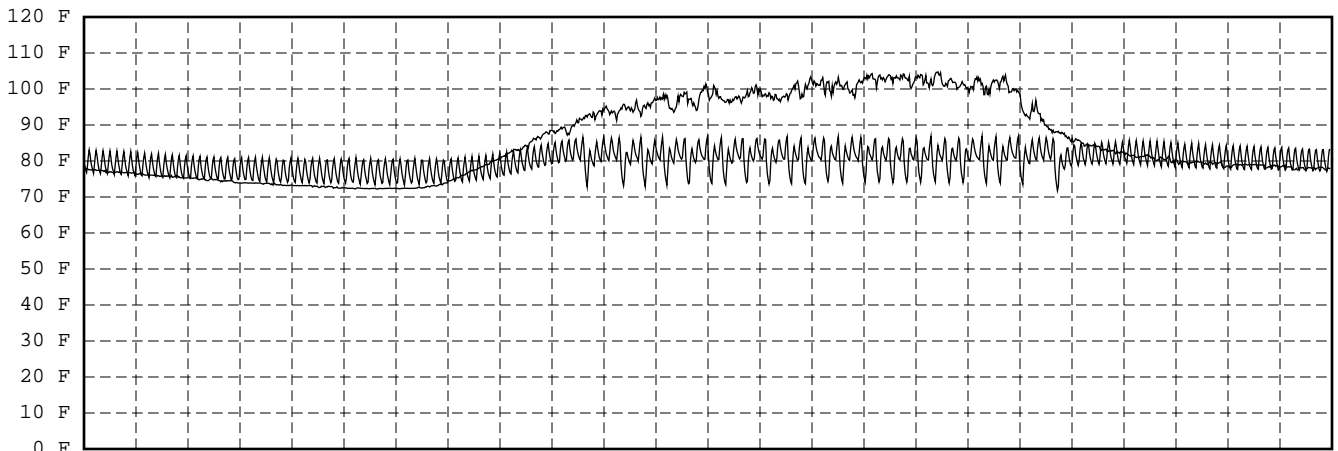

LINE VOLTAGE

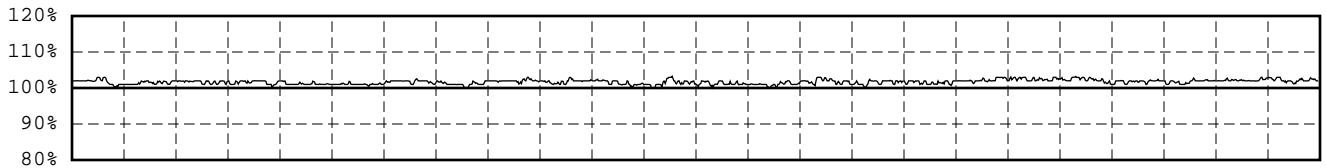

AUTOMATIC A/C AND FAN STATES

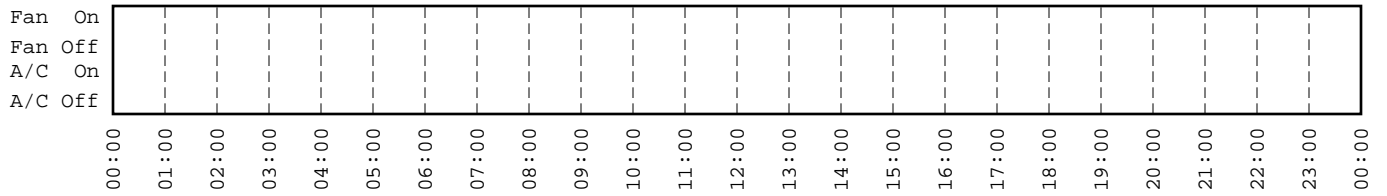

Time	ERP	Line Voltage	Exterior Temperature	Interior Temperature	Tower Lights
00:00 CDT	6121 W (122%)	102 %	78 F	80 F	
02:00 CDT	6137 W (123%)	102 %	75 F	77 F	
04:00 CDT	6120 W (122%)	102 %	73 F	78 F	
06:00 CDT	6154 W (123%)	101 %	72 F	75 F	
08:00 CDT	6110 W (122%)	102 %	81 F	82 F	
10:00 CDT	6055 W (121%)	102 %	94 F	87 F	
12:00 CDT	6065 W (121%)	101 %	99 F	87 F	
14:00 CDT	6093 W (122%)	101 %	103 F	80 F	
16:00 CDT	6077 W (122%)	102 %	103 F	85 F	
18:00 CDT	6080 W (122%)	102 %	99 F	81 F	
20:00 CDT	6087 W (122%)	101 %	82 F	84 F	
22:00 CDT	6090 W (122%)	102 %	79 F	82 F	